


OVERHEAD VERTICAL CLEARANCES TO CONDUCTORS

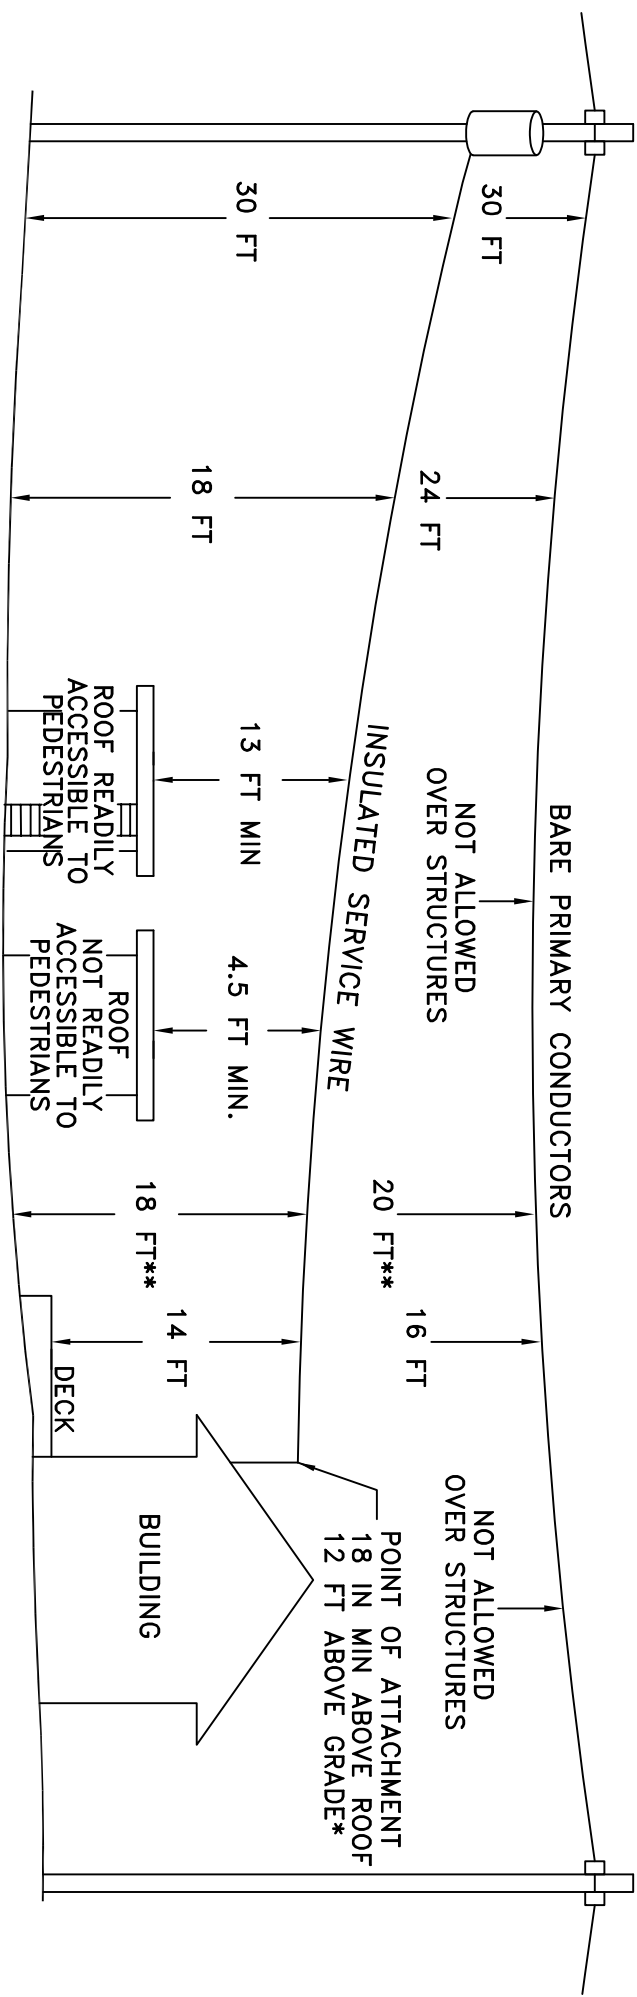

STATE HWYS
STREETS, ALLEYS,
COUNTY ROADS
LAND ACCESSED BY
VEHICLE OR EQUESTRIAN

ROOF READILY
ACCESSIBLE TO
PEDESTRIANS
13 FT MIN
ROOF
NOT READILY
ACCESSIBLE TO
PEDESTRIANS
4.5 FT MIN.

RESIDENTIAL
PROPERTY/
DRIVEWAY
18 FT**
CULTIVATED FIELDS
ORCHARDS SUBJECT
TO VEHICLE TRAFFIC
14 FT
DECK

BUILDING
POINT OF ATTACHMENT
18 IN MIN ABOVE ROOF
12 FT ABOVE GRADE*

RESIDENTIAL
PROPERTY/
DRIVEWAY
18 FT**
CULTIVATED FIELDS
ORCHARDS SUBJECT
TO VEHICLE TRAFFIC
14 FT
DECK

* (MINIMUM) INCREASE AS
NEEDED TO MAINTAIN PROPER
CLEARANCES OVER OTHER
SURFACES (CONSULT INLAND
POWER & LIGHT)

**INCREASE TO 30' IN
AREAS SUBJECT TO
FARM EQUIPMENT

SWIMMING POOLS AND HOT TUBS
NEITHER PRIMARY OR SECONDARY
WIRES ALLOWED TO CROSS OVER

NOTE:
CONTACT IPL FOR CLEARANCE
REQUIREMENTS TO GRAIN BINS,
BILLBOARDS, SIGNS, ANTENNAS,
FLAG POLES OR OTHER EQUIPMENT
FOR PROPANE TANKS, PLEASE
REFER TO THE NFPA CODE
REQUIREMENTS FOR CLEARANCE
INFORMATION.

Inland Power
AND LIGHT COMPANY

VERTICAL CLEARANCES			
NO.	DATE	REVISION DESCRIPTION	BY
			DRWN BY CMN
			1-17-2022