


# OVERHEAD HORIZONTAL CLEARANCES TO CONDUCTORS

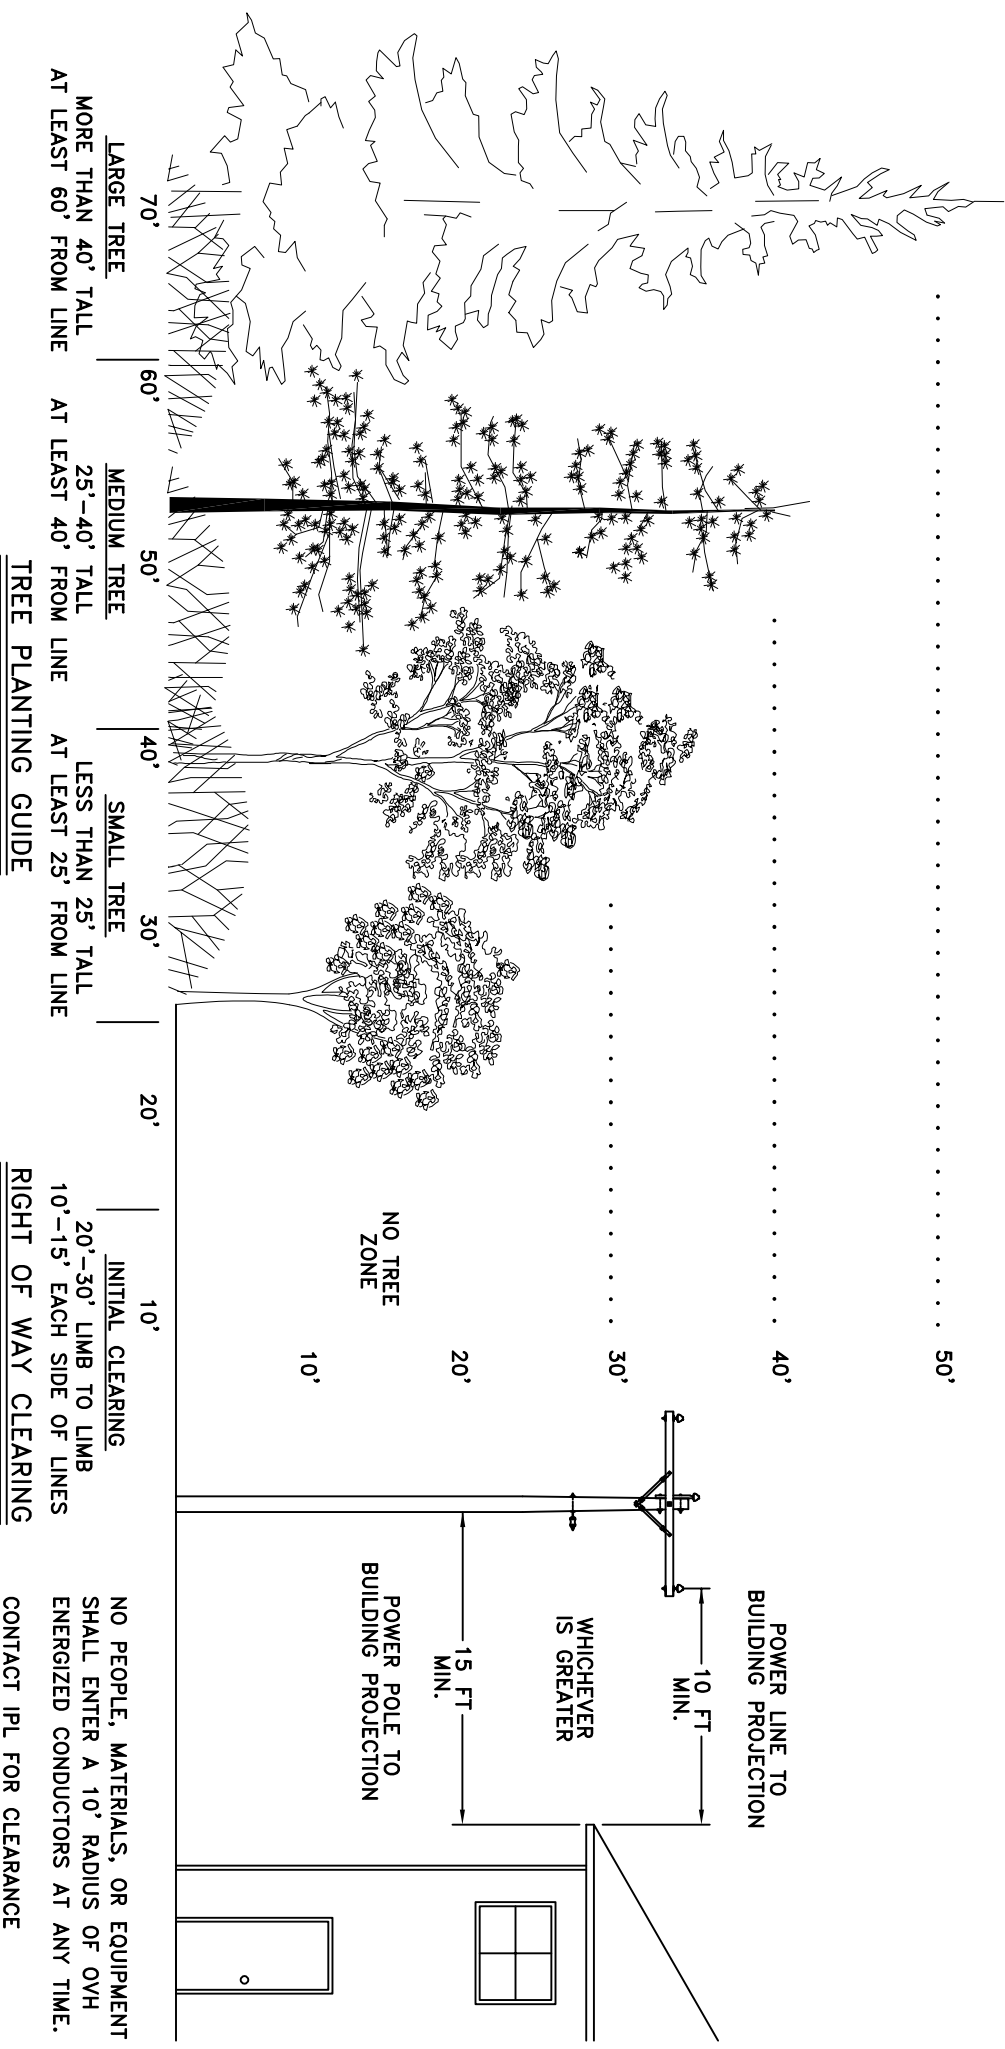

ON ALL NEW SERVICES, THE MEMBER WILL BE REQUIRED TO CLEAR THE INITIAL RIGHT-OF-WAY BASED ON INLAND POWER & LIGHT (IPL) SPECIFICATIONS. THE IPL ARBORIST WILL BE IN CONTACT WITH THE MEMBER TO DISCUSS THE REQUIRED SPECIFICATIONS AND TO SHOW THE MEMBER WHAT TREES/BRUSH NEED TO BE TRIMMED OR REMOVED. IPL CREWS WILL DO ALL CLEARING WITHIN THE STATE AND COUNTY RIGHT-OF-WAY AND THE MEMBER WILL BE INVOICED FOR THIS SERVICE. MEMBERS WILL NOT BE PUT ON THE CONSTRUCTION SCHEDULE UNTIL THE RIGHT-OF-WAY HAS BEEN INSPECTED AND APPROVED BY INLAND'S ARBORIST. AFTER CONSTRUCTION IS COMPLETED, IPL WILL HANDLE ALL FUTURE RIGHT-OF-WAY TRIMMING/REMOVALS.

\*\*\*\*\*PLEASE DO NOT PLANT TREES UNDER THE POWER LINES THAT WILL GROW TALL ENOUGH TO REACH POWER LINES.\*\*\*\*\*  
 IF YOU HAVE ANY QUESTIONS, PLEASE CONTACT INLAND POWER & LIGHT'S ARBORIST AT (509) 747-7151 EXT 287

NO PEOPLE, MATERIALS, OR EQUIPMENT SHALL ENTER A 10' RADIUS OF OVH ENERGIZED CONDUCTORS AT ANY TIME.

CONTACT IPL FOR CLEARANCE REQUIREMENTS TO GRAIN BINS, BILLBOARDS, SIGNS, ANTENNAS, FLAG POLES OR OTHER EQUIPMENT FOR PROPANE TANKS, PLEASE REFER TO THE NFPA CODE REQUIREMENTS FOR CLEARANCE INFORMATION.

### CLEARANCE TO BUILDINGS

**Inland Power**  
AND LIGHT COMPANY

NO.	DATE	REVISION DESCRIPTION	BY	DRWN BY
1	1/22	ADD R.O.W. NOTES	CMN	1-17-2022

### HORIZONTAL CLEARANCES